

Deck Construction Guide


BP# _____
 Joist Size x @ "o/c
 Beam Size: x @ ' max. span
 Cantilever Length ' max.

Decks to be designed for 60 p.s.f live load as per a.a. county code bill 75-91

* Do not support framing load on existing chimney.

* Decks are not approved for future installation of hot tubs.

* If deck attaches to an existing cantilever a second beam is required.

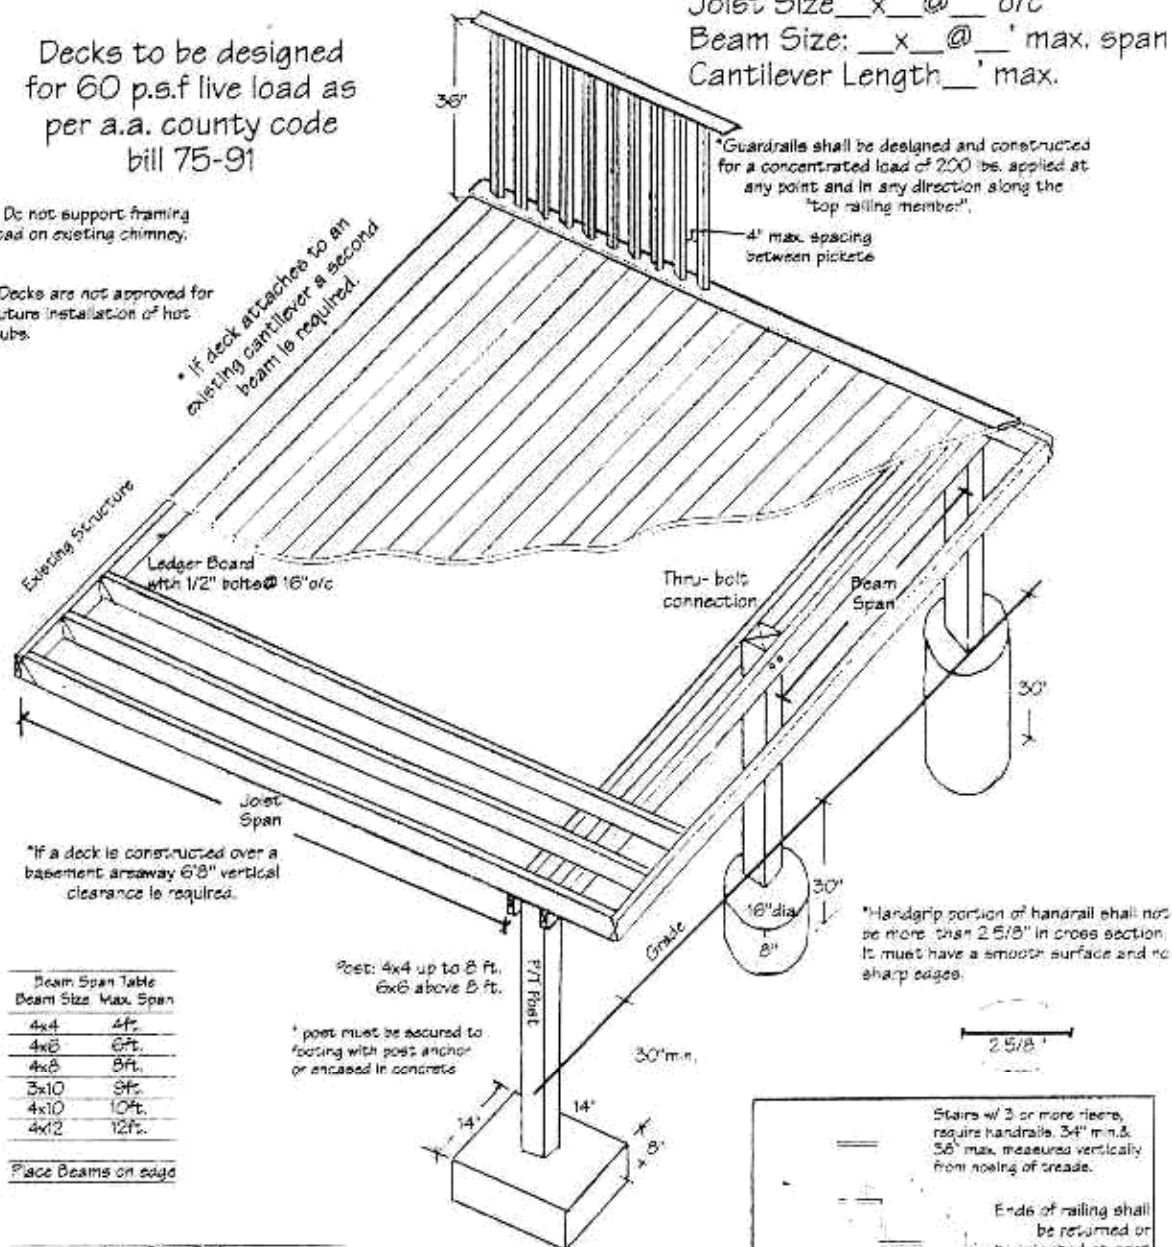


* If a deck is constructed over a basement, an 8" vertical clearance is required.

Beam Size	Max. Span
4x4	4ft.
4x6	6ft.
4x8	8ft.
3x10	9ft.
4x10	10ft.
4x12	12ft.

Place Beams on edge

Joist Size	Joist Spacing			Maximum Cantilever
	12"	16"	24"	
2x6	8'	6'	5'	
2x8	10'	8'	7'	2 ft.
2x10	13'	10'	8'	3 ft.
2x12	17'	14'	10'	4 ft.

* Exceeds Beam Span Table. Calculate Separately

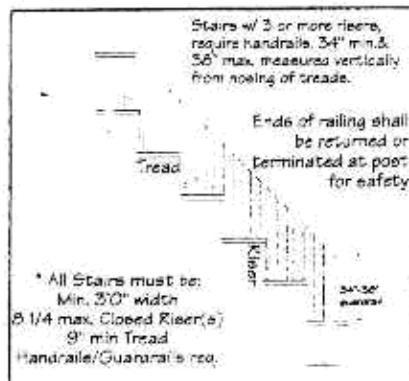

Attachment "A"

REV. 6/96